


CLEANOUT OUTSIDE INTERCEPTOR
TO BE LOCATED IN CONFORMANCE
WITH COMAR 09.04

SECOND ENTRANCE
REQUIRED FOR
VENTILATION,
LIGHTING AND SAFETY

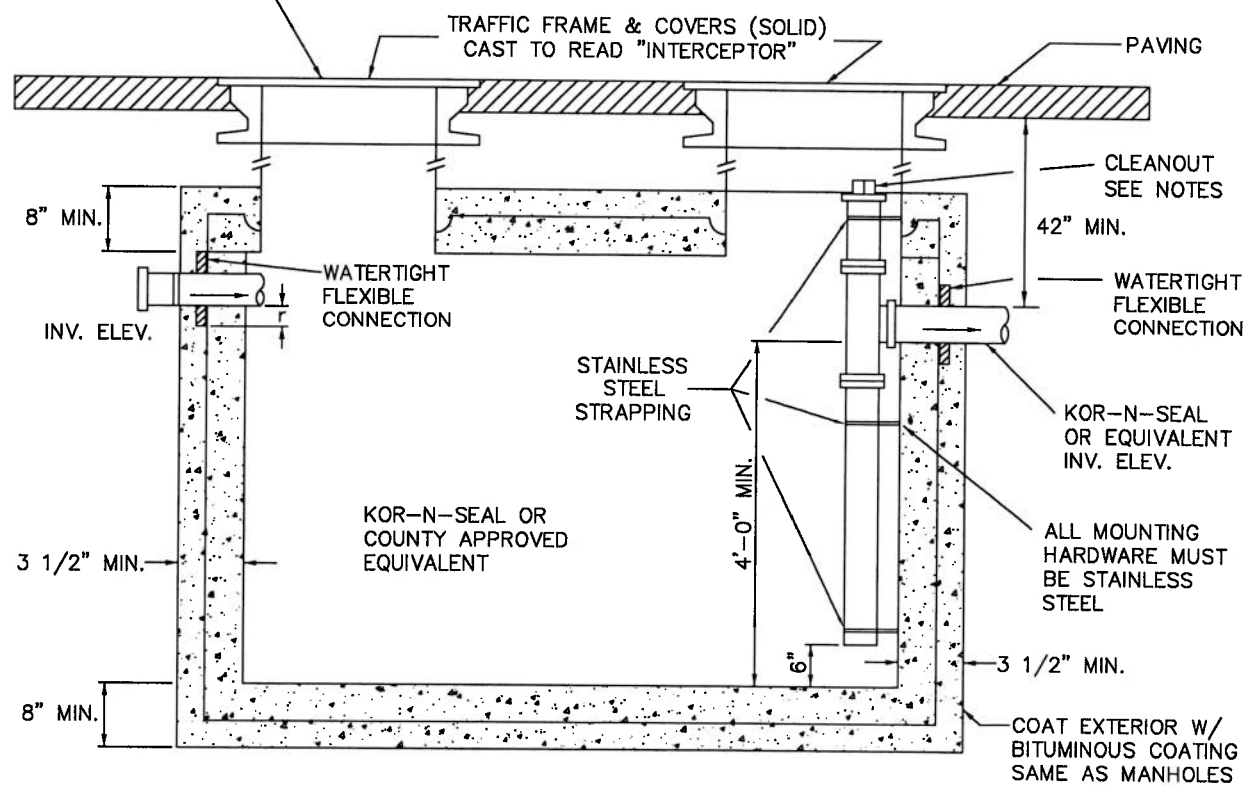

USE SCHEDULE 40 PVC PIPE AND FITTINGS } LARGER AS DIRECTED BY
MINIMUM 2000 GALLON GREASE TRAP } WATER / SEWER ENGINEER
UPON REVIEW OF MENU ITEMS

TANK AND ALL COMPONENTS SHALL BE DESIGNED FOR TRUCK LOADINGS (1-120).

NOTES:

1. PROVIDE STRAPPING ON INTERIOR VERTICAL CLEANOUT STACK STARTING AT 6 IN ON EACH END OF PIPE AND EVERY 3.0 FT. MUST BE STAINLESS STEEL.
2. MINIMUM 42 IN COVER ON SEWER PIPE.
3. CLEANOUT CAP TOP MINIMUM 12 IN BELOW FINISHED GRADE.
4. DRILL A 3/8 IN HOLE IN CLEANOUT CAP.

CHARLES COUNTY GOVERNMENT
DEPARTMENT OF PLANNING & GROWTH MANAGEMENT

APPROVED: _____ DATE _____
CHIEF OF CODES, PERMITS, & INSPECTION SERVICES

WATER / SEWER ENGINEER DATE _____

STANDARD DETAIL

OUTSIDE
GREASE TRAP
(INTERCEPTOR)

REVISIONS:
R.O.M. 2/10/2022

S
5.04