


PLAN



PROFILE

- NOTES:
1. INSTALL W.H.C. LEVEL WITH TOP OF MAIN METER, UNLESS OTHERWISE DIRECTED BY THE ENGINEER.
 2. WHEN W.H.C. AND S.H.C. ARE INSTALLED IN SAME TRENCH, SEE M/2.01.
 3. CORPORATION STOP TO BE LEFT OPEN, BALL VALVE IN METER PIT CLOSED.
 4. METER BOX NOT TO BE LOCATED IN PAVED/TRAFFIC AREAS/SIDEWALK/DRIVEWAY.
 5. SEE DETAIL W/6.14, W/6.15 AND SPECIFICATION SECTION 02553.02.C FOR METER SETTING.

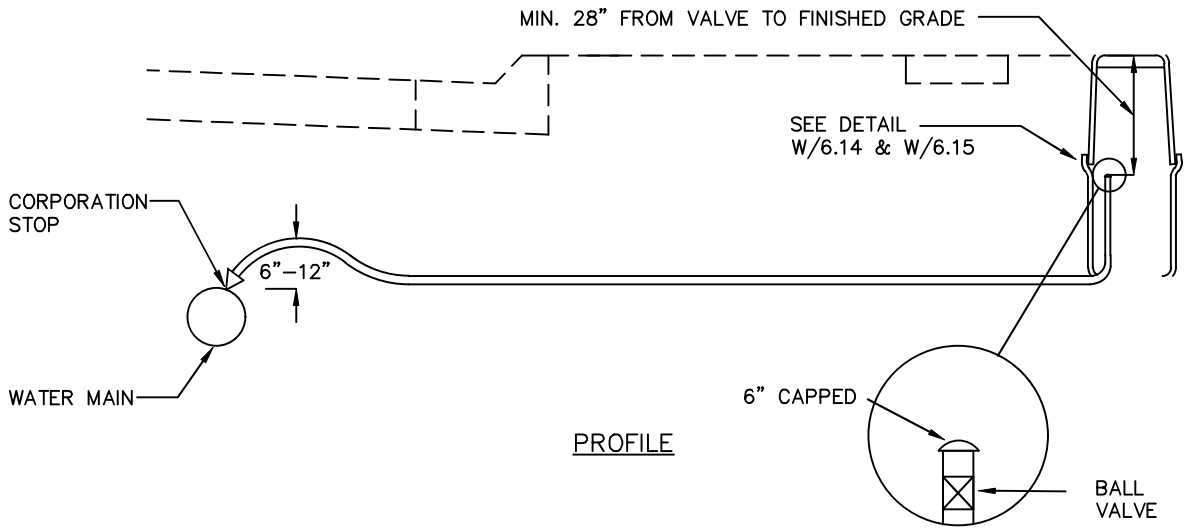

CHARLES COUNTY GOVERNMENT
 DEPARTMENT OF PLANNING & GROWTH MANAGEMENT
 APPROVED: Raymond N. Shumaker, Jr. Oct 5, 2022
Raymond N. Shumaker, Jr. (Oct 5, 2022 12:20 EDT)
 CHIEF OF CODES, PERMITS, & INSPECTION SERVICES
 DATE
Professional Engineer Signature Oct 5, 2022
 PROFESSIONAL ENGINEER DATE

STANDARD DETAIL
 INSTALLATION OF WATER HOUSE CONNECTION WITH OUTSIDE METER

W
2.01
REVISIONS:
MAY 2005
JANUARY 2007
SEPTEMBER 2022