


NOTES

1. FOR FIRE HYDRANT MINIMUM REQUIREMENTS REFER TO W-5.00
2. MANUFACTURER GRADELOK. AVAILABLE IN 6 AND 12 INCH OFFSET

	6"X6"	6"X12"	6"X24"	6"X6" MJ	6"X12" MJ	6"X24" MJ
wt.(lbs.)	72	100	140	76	106	140
A	6"	12"	24"	6"	12"	24"
B	18"	30"	41"	18"	30"	41"
C	6.90"	6.90"	6.90"	6.90"	6.90"	6.90"
D	0.37"	0.37"	0.37"	0.37"	0.37"	0.37"

AVAILABLE SIZES

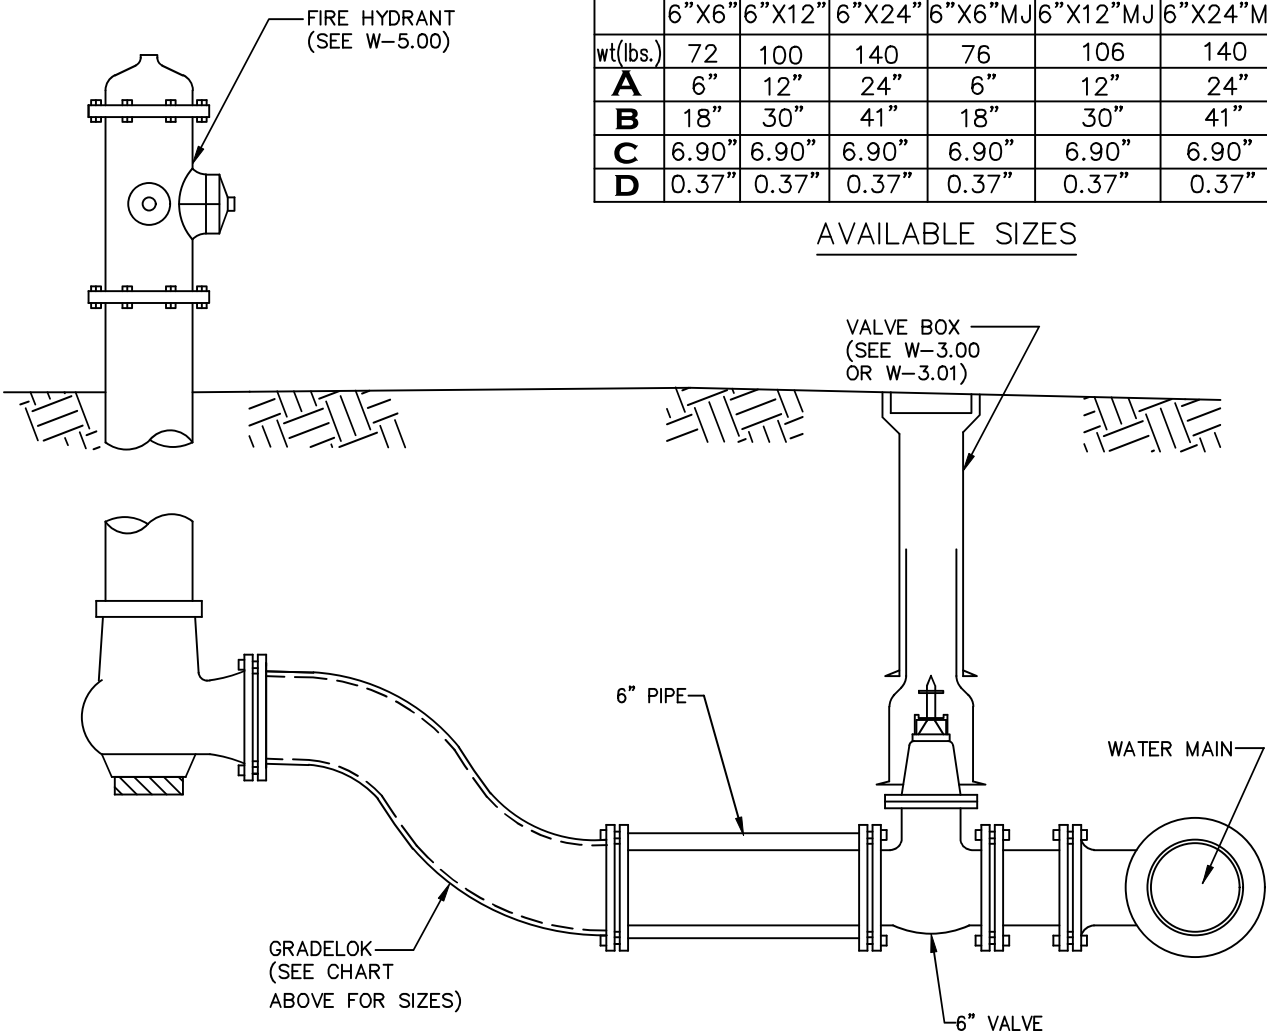

CHARLES COUNTY GOVERNMENT

DEPARTMENT OF PLANNING & GROWTH MANAGEMENT

APPROVED: Raymond N. Shumaker, Jr. Oct 5, 2022
Raymond N. Shumaker, Jr. (Oct 5, 2022 12:20 EDT)
 CHIEF OF CODES, PERMITS, & INSPECTION SERVICES DATE

J.B. Bill Oct 5, 2022
 PROFESSIONAL ENGINEER DATE

STANDARD DETAIL

FIRE HYDRANT
 ADJUSTMENT
 (S - BEND)

W
5.00-A

REVISIONS:
