

FIRE HYDRANT GUARD

FIRE HYDRANT NOTES


USE HYDRANT GUARDS AT ALL FIRE HYDRANTS. (2 EACH HYDRANT) AS REQUIRED BY THE COUNTY.
3" PIPE TO BE FILLED WITH CONCRETE AND PAINTED RED WITH REFLECTIVE YELLOW STRIPS (PER SPECIFICATIONS).

(2) REFLECTIVE

WHITE TAPE

3" PIPE

- 3. HYDRANT TO BE PAINTED YELLOW, PÉR SPECIFICATIONS.
- 4. CONTRACTOR TO FURNISH ONE FIRE HYDRANT WRENCH FOR THE PROJECT.
- 5. REFLECTIVE WHITE TAPE SHOULD MEET DOT SPECIFICATIONS FP-85 FOR TYPE II SHEETING. IT SHOULD BE 3" O.C. FROM

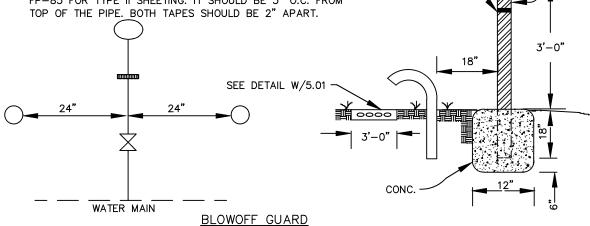

BLOWOFF NOTES

- 1. USE BLOWOFF GUARDS AT ALL BLOWOFFS. (2 EACH BLOWOFF) AS REQUIRED BY THE COUNTY.
- 3" PIPE TO BE FILLED WITH CONC. AND PAINTED RED WITH YELLOW STRIPS.
- 3. BLOWOFF NOZZLE TO BE PAINTED YELLOW.

