


NOTES:

1. FOR SEWERS 15" AND SMALLER DIAMETER, DISCONNECT SEWER AS SHOWN, INSERT MECHANICAL PLUGS, PLACE CONCRETE, PARGING AND COAT WITH TWO COATS OF ASPHALT BASED COATING.
2. FOR SEWER 18" AND LARGER DIAMETER SAME AS 15" AND SMALLER EXCEPT MASONRY BULK-HEAD MAY BE SUBSTITUTED FOR MECHANICAL PLUG.
3. RESHAPE AND FILL EXISTING CHANNEL AS NECESSARY TO PROVIDE SMOOTH CONTOUR BETWEEN INCOMING AND OUTGOING PIPES.
4. WHEN ABANDONING A DROP MANHOLE CONNECTION REMOVE THE DROP CONNECTION, ABANDON THE LINE, SEAL THE PENETRATION FROM THE ABANDONED DROP CONNECTION, AND RECONFIGURE THE CHANNEL ACCORDINGLY.
5. REFER TO CHARLES COUNTY SPECIFICATIONS SECTION 02150 FOR PIPE ABANDONMENT REQUIREMENTS.

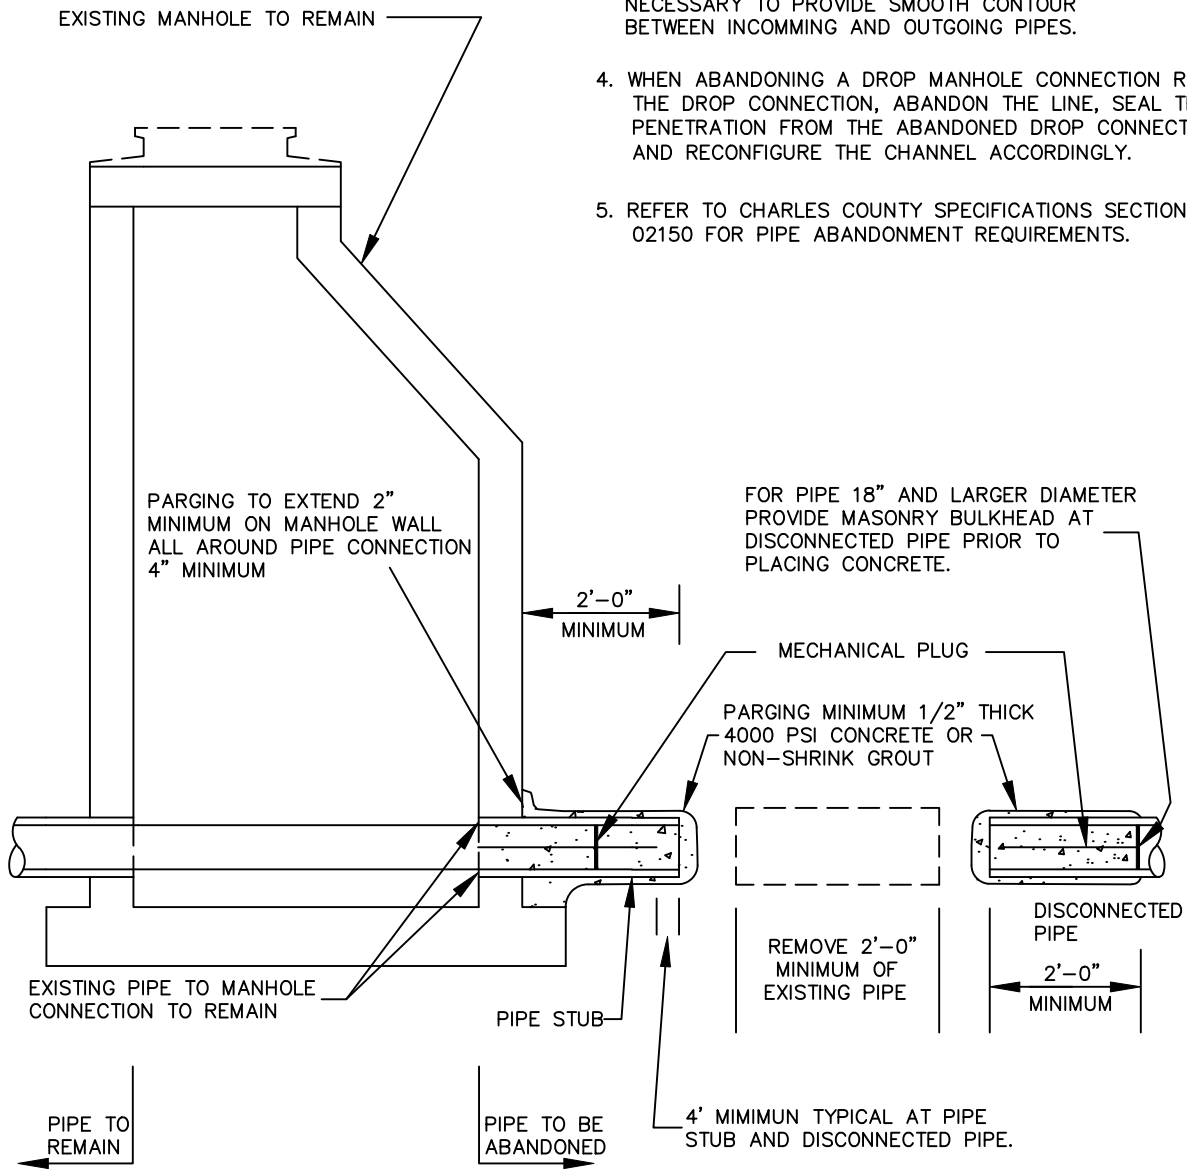

CHARLES COUNTY GOVERNMENT

DEPARTMENT OF PLANNING & GROWTH MANAGEMENT

APPROVED: Raymond N. Shumaker, Jr. Aug 8, 2023  
Raymond N. Shumaker, Jr. (Aug 8, 2023 12:00 EDT)  
 CHIEF OF CODES, PERMITS, & INSPECTION SERVICES DATE

Andy B. Smith Aug 8, 2023  
Andy B. Smith (Aug 8, 2023 14:40 EDT)  
 PROFESSIONAL ENGINEER DATE

STANDARD DETAIL

ABANDONMENT OF PIPE AT MANHOLE SANITARY SEWER

S

1.11

REVISIONS:  
 DECEMBER 2022