


D	A	W	B
3" & 4"	3"	12"	6"
6"	4"	11"	6"
8"	5"	10"	6"
10"	5"	9"	6"
12"	5"	8"	6"
15"	5"	8"	6"
16" & 18"	6"	8"	6"
20" & 21"	7"	8"	6"
24"	8"	12"	6"
27"	8"	12"	6"
30"	9"	12"	6"
33"	10"	15"	6"
36"	10"	15"	6"
42"	13"	15"	6"
48"	15"	18"	6"
54"	16"	18"	6"
60"	18"	18"	6"
66"	21"	18"	6"
72"	21"	18"	6"
78"	23"	18"	6"
84"	25"	18"	6"
90"	26"	18"	6"
96"	28"	18"	12"
102"	30"	18"	12"
108"	32"	18"	12"
114"	34"	24"	12"
120"	36"	24"	12"

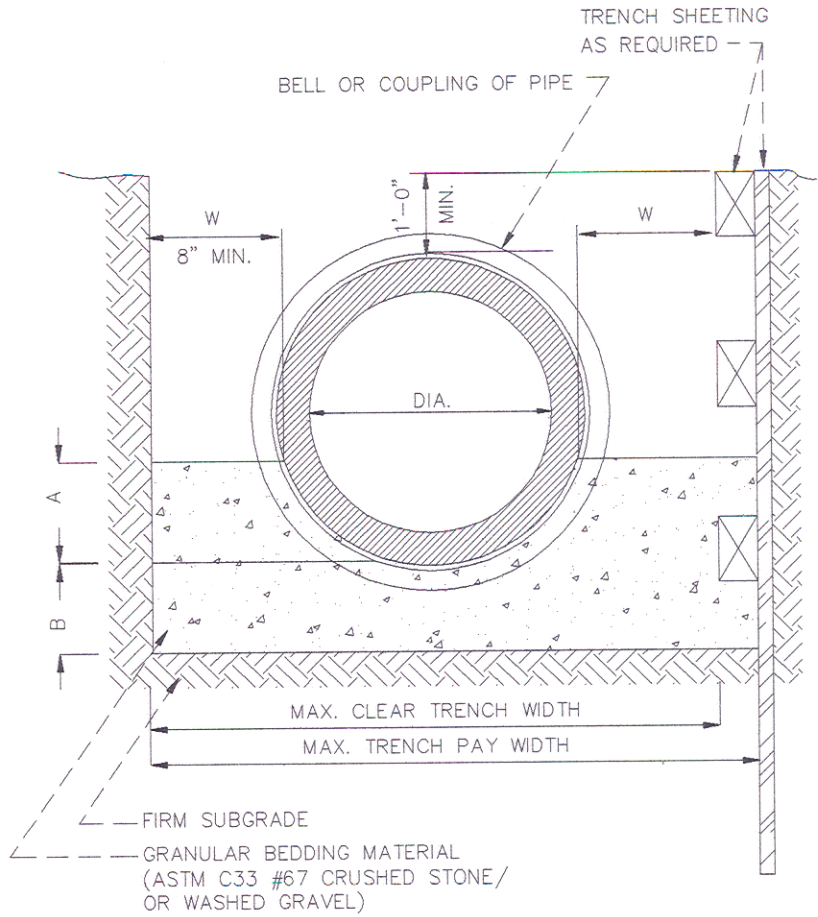

NOTES:

1. (FOR BEDDING OF P.V.C. PIPE SEE DETAIL M/2.04).
2. WHERE SPECIFICALLY REQUIRED, $f_c=2000$ psi @ 28 DAYS CONCRETE AND SADDLE BLOCKS SHALL BE USED IN LIEU OF THE GRAVEL CRADLE.
3. ALL BEDDING MATERIAL SHALL BE IN ACCORDANCE WITH THE TYPICAL SPECIFICATIONS.
4. MAXIMUM CLEAR TRENCH WIDTH SHALL BE $2W$ PLUS THE OUTSIDE DIAMETER OF THE PIPE.
5. BEDDING MATERIAL FOR ELLIPTICAL PIPE SEE SPECIFICATIONS AND FOR AMOUNT SEE CONTRACT DRAWINGS.
6. BEDDING REQUIRED FOR SANITARY SEWER. 6 INCHES UNDER PIPE AND FILL TO TOP OF PIPE.

CHARLES COUNTY GOVERNMENT

DEPARTMENT OF PLANNING & GROWTH MANAGEMENT

APPROVED:

Michael J. ... 6/29/95
DIRECTOR OF DEVELOPMENT SERVICES DATE

Walter H. ... 6/29/95
WATER / SEWER ENGINEER DATE

STANDARD DETAIL

BEDDING AND TRENCH WIDTHS FOR DUCTILE IRON SANITARY SEWER PIPE

REVISIONS:

M
2.02