


D	W
8"	10"
10"	9"
12-21"	8"

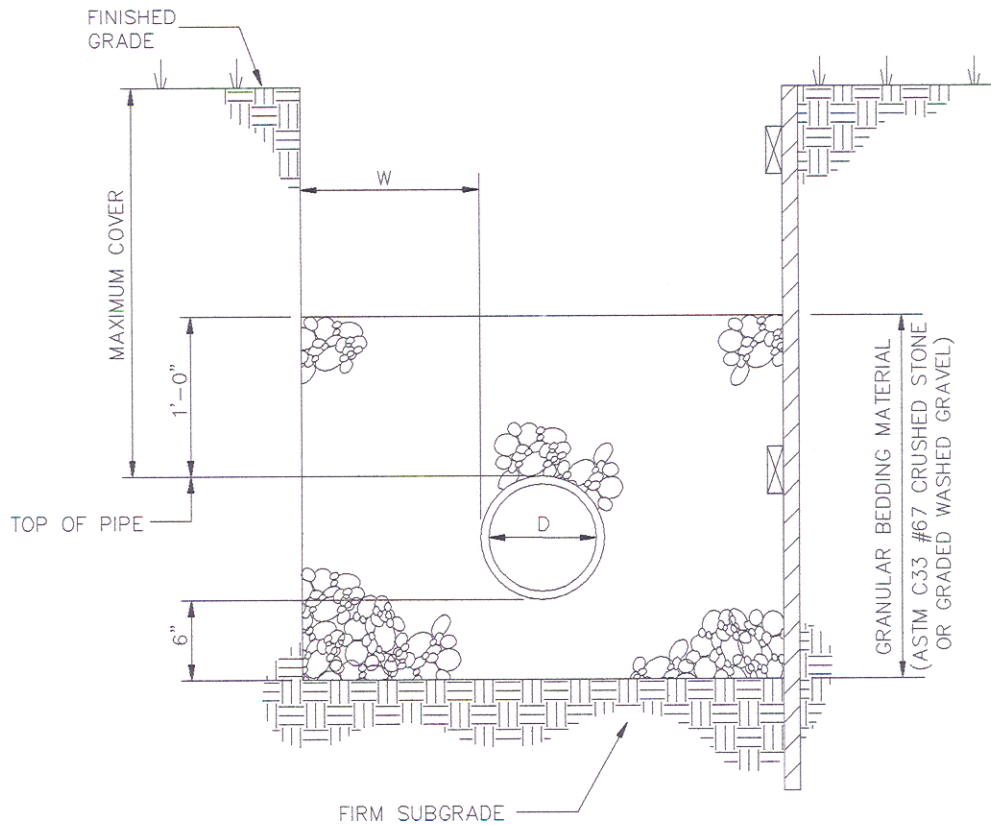

NOTES:

1. WHERE TRENCH WALLS BELOW TOP OF PIPE ARE UNSTABLE AND REQUIRE SUPPORT TO MAINTAIN TRENCH DIMENSION, THE SUPPORT SHALL BE LEFT IN PLACE.
2. MAXIMUM COVER = 15'-0".
3. DETAIL APPLIES TO PVC PIPE.
4. IF SUBGRADE IS NOT STABLE, UTILIZE ASTM C33 #2 OR #3 CRUSHED STONE STABILIZE AND TRANSMIT GROUNDWATER. ORIGINAL BEDDING DETAIL TO BE UTILIZED OVER THE SUBGRADE STONE STABILIZATION.

CHARLES COUNTY GOVERNMENT

DEPARTMENT OF PLANNING & GROWTH MANAGEMENT

APPROVED:

*[Signature]* 6/29/95  
DIRECTOR OF DEVELOPMENT SERVICES DATE

*[Signature]* 6/29/95  
WATER / SEWER ENGINEER DATE

STANDARD DETAIL  
 BEDDING, EMBEDMENT  
 AND MAXIMUM  
 COVER PVC PIPE

REVISIONS:


M  
 2.04